

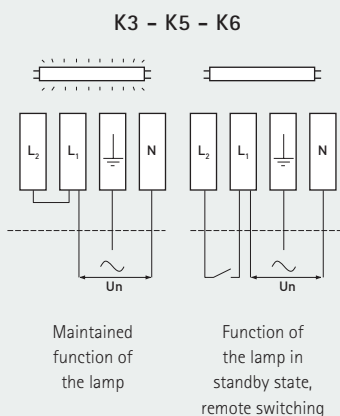


WIRING DIAGRAMS






EMERGENCY LIGHTING

SELF CONTAINED LUMINAIRES OF THE MAINTAINED TYPE WITH FLUORESCENT LAMPS

LUMINAIRES FOR EBS Compact

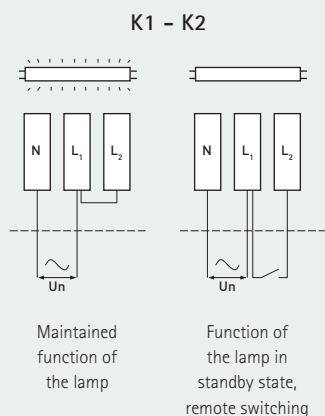

CONNECTION OF SELF CONTAINED AND CENTRALLY SUPPLIED LUMINAIRES




SET UP OF NON-MAINTAINED OR MAINTAINED OPERATION



K1 - K2 - K3 - K7 INHIBITING MODE

K7 SIGNAGE	signage	module
standard configuration		maintained
removal of 1 st jumper		non-maintained
removal of 2 nd jumper		maintained


K9 SIGNAGE

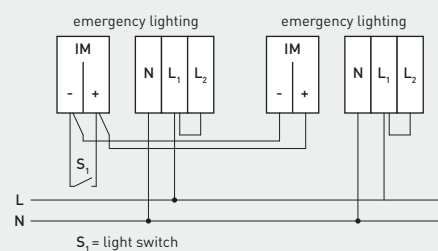


ETAP SAFETY MANAGER (ESM): WIRED / WIRELESS

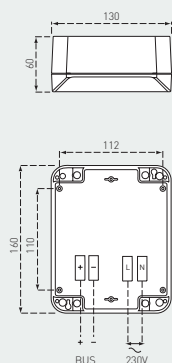BUS connection
luminaire

Coordinator wireless
communication

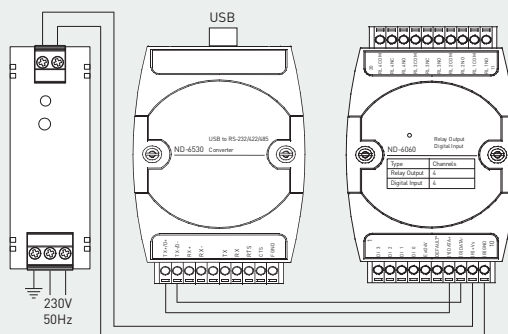
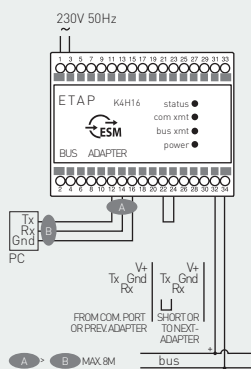
Volt-free contact




BUS power supply K4H12




BUS adapter K4H16



Connecting multiple BUS adapters

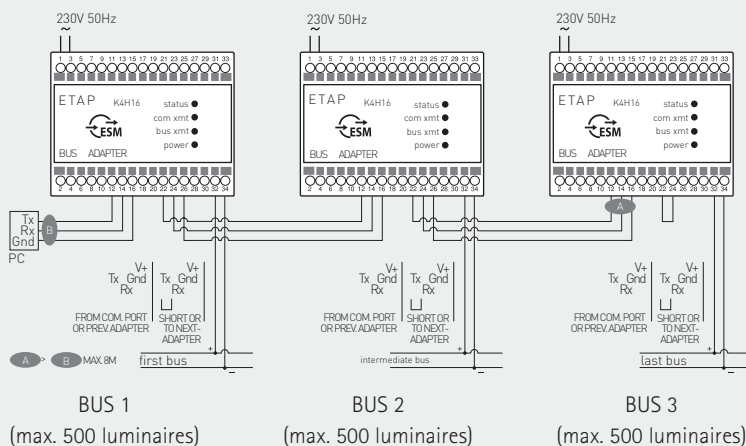

Com - Server

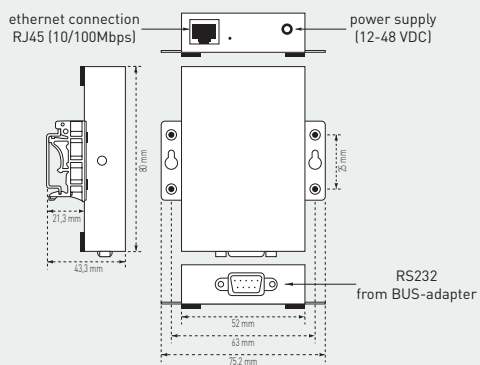

EUG

